

19,075



September 9, 2024

WR:3615729

WO:20400997

FILED FOR RECORD
at 1:00 o'clock P M

SEP 24 2024

BECKY LANDRUM
County Clerk, Hunt County, Tex.
By

HUNT COUNTY PERMIT

Statement of Work: Reconductor (1)#4 ACSR to (3)4/0 ACSR from SID 3318943 -09627175 to SID 1846360 -6699756.

We are applying for a county permit due to crossing over County Road 1124. WP10, which is located at the intersection of FM-36 and County Rd 1124, will be replaced and upgraded. The utility line that is crossing the road to WP11 will be reconducted to a larger size. WP11 is a new install right along the County Road.

The total Work Order has 54 Workstations most of which are within TXDOT ROW or private property. However, there is only one instance where a county road is crossed overhead, and a county permit is required.

Scott Faulkner

Oncor | Program Services

Tel: 817-355-7021

Cell: 817-513-7136

DocuSigned by:


A83E6B01C4B244E ...
9/10/2024

I: HDPE 6"

County RD 1124

Span Length: 50 ft

Span Length: 50 ft



POLE MATERIAL: WOOD UNLESS OTHERWISE NOTED
POLE DIAMETER: 12"-17" UNLESS OTHERWISE NOTED
ALL POLES WILL BE INSTALLED NO FURTHER THAN 3' WITHIN THE ROW

(2) The utility shall erect at each end of the utility's installation an informational sign, as shown in Figure S2.1.38(c)(2), for all work associated with a utility facility on the department's right of way. Contractor information is optional, but the sign must have the utility's contact information.

ELECTRIC CONSTRUCTION PRINT


WD Number: **20400997-01** Date: **2022/12/22** Description: **2023MCE11015P CELSTE LEDSOS P1 S4**

Sheet: **3 of 13** Scale: **1"=80'** Customer: **Onco**

Job Status: **Design** Ser Ctr / Office: **CEL/CEL** Address: **1520 N FM 36, HUNT 75442**

Designer: **SETLIFE, RYAN/UBS** 843-476-5403 Location: **Galena, TX**

Project Mgr: **Brennan Harrington/JW** 817-286-4230

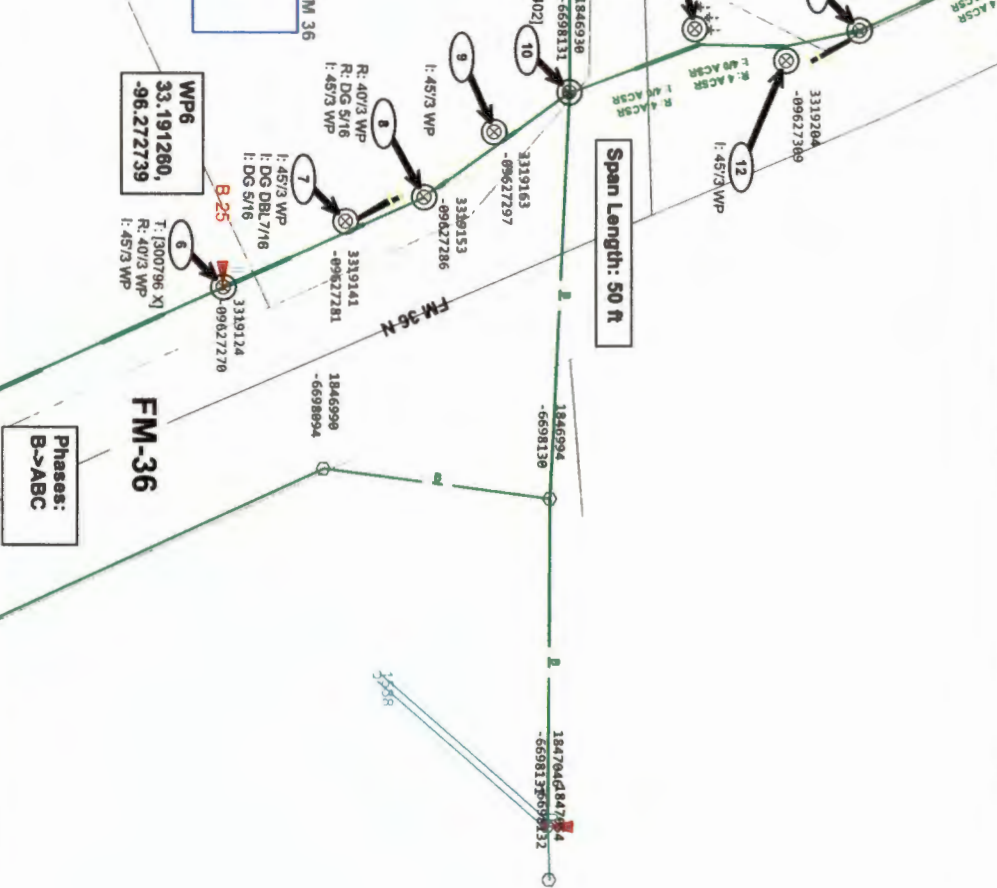

IT IS THE RESPONSIBILITY OF THE UTILITY TO NOTIFY TDDOT VIA THE UIR SYSTEM 48 HOURS PRIOR TO START OF CONSTRUCTION.

CONTRACTORS, YOU ARE TO CALL:
 1. Ryan Seiffert FOR UIR ELECTRONIC NOTIFICATION
 1.2. THE TDDOT INSPECTOR NOTED ON THE APPROVED PERMIT 48-HOURS PRIOR TO THE START OF CONSTRUCTION

- (S4) Reconductor (1)#4 ACSR to (3)#10 ACSR from WP10 to WP54
- (S4) Reconductor (1)#2 ACSR to (3)#10 ACSR from WP1 to WP10

Stack Span from WP 7 to 13

Voltage: 25kV
 Protective Device: Recloser
 FID: 394628

Phases: B->ABC

UIR ELECTRONIC NOTIFICATION CONTACT:
 Ryan Seiffert
 EMAIL: Ryan.Seiffert@tds.com
 PHONE: 832-476-5403

Copyright 2018 Onco Electric Delivery, a unit of Onco Energy, and its associated products are created for the intended purposes of Onco Electric Delivery with no representation of liability or fitness for the intended use of the recipient. Onco Electric Delivery, a unit of Onco Energy, and its associated products are created for the intended purposes of Onco Electric Delivery with no representation of liability or fitness for the intended use of the recipient. Onco Electric Delivery, a unit of Onco Energy, and its associated products are created for the intended purposes of Onco Electric Delivery with no representation of liability or fitness for the intended use of the recipient. Onco Electric Delivery, a unit of Onco Energy, and its associated products are created for the intended purposes of Onco Electric Delivery with no representation of liability or fitness for the intended use of the recipient. Onco Electric Delivery, a unit of Onco Energy, and its associated products are created for the intended purposes of Onco Electric Delivery with no representation of liability or fitness for the intended use of the recipient.