




20345
**Farmers Electric
Cooperative**

2000 I-30 E
Greenville, TX 75402

Tuesday, August 25, 2026

County: Hunt County

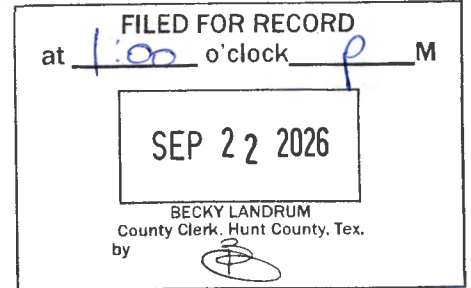

Farmers Electric Cooperative Member: Christopher Reeves
Service Order Number: 2026083214

Greetings:

Farmers Electric Cooperative, Inc. is requesting permission to construct electrical power distribution facilities which will cross County Road 3226 at pole 108052 which is 8357' SW of CR 1135.

Site location map/construction sketches are attached. The construction sketch details the proposed work. The proposed electrical service will be constructed:

- ☒ Overhead - All road crossings will have a minimum vertical clearance of 22 feet.
☐ Underground - All underground bore crossings are PVC encased 4' of coverage from the lowest point of the Right of Way.

If you have any questions, please contact me at any time.

Sincerely,

Psalm Harper
pharper@farmerselectric.coop
Engineering Coordinator


Enclosures

County Approval Section:

Approved: _____

Denied: _____

Authorized Signature: _____ Date: _____

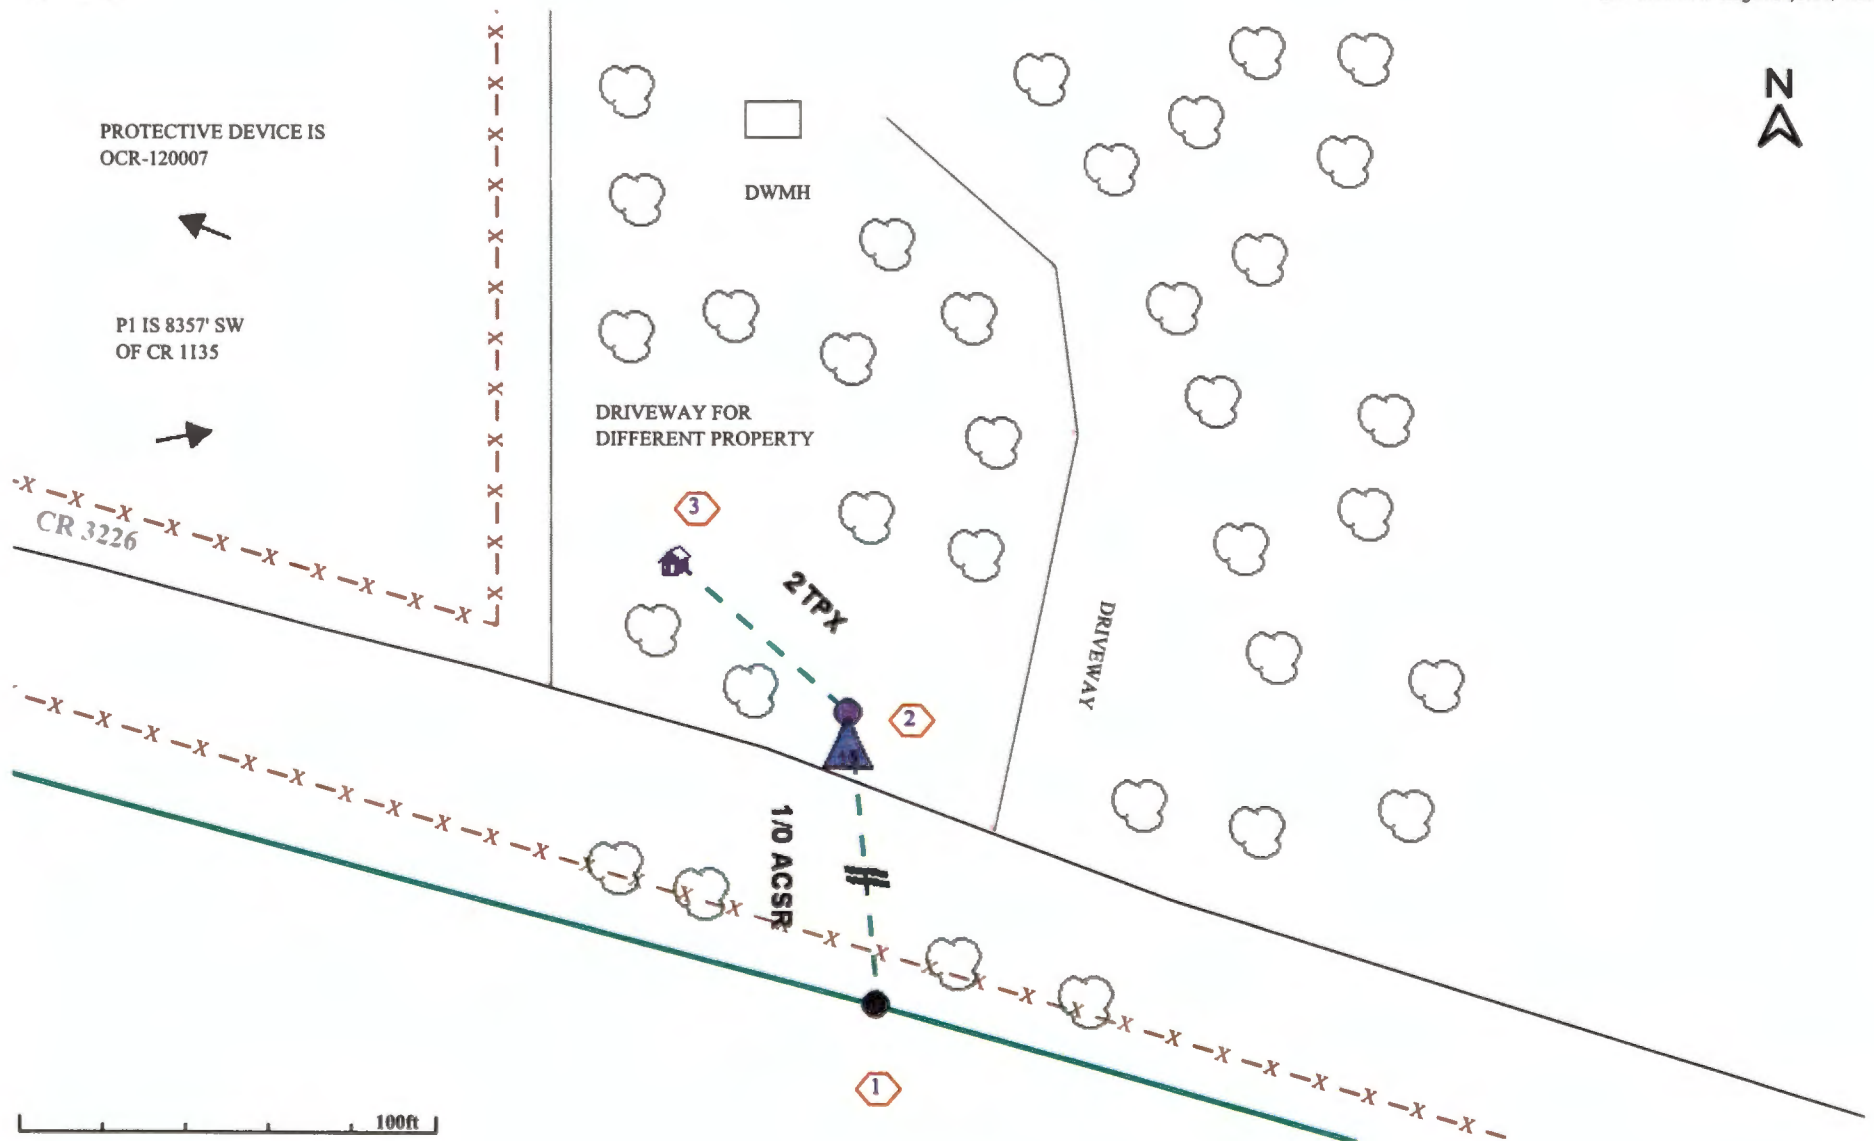



W.O. NO: 2026083214.11

City:

Member: CHRISTOPHER REEVES

Last Generated: August 24, 2026, 4:23:29 PM

Staked By: jthomas - 08

Subdivision:

Grid No: 1433010170059

Restaked:

County: HUNT

Source and Feeder: 1406

School:

Crew:

PJN: JT 2026083214 REEVES

911 Address: 6598 COUNTY ROAD

Completed By:

OH MP Not Ready 08

7.2KV

1 Source: none Phase: B PHASE Span: 0 Comments: POLE 108052 Existing (1) 40-4 (C) Existing (0) 4 ACSR (C) Existing (1) VA1 (C) Existing (1) VM2-12 (C) New (1) SC30 (H) New (1) VA5-1E (H) New (1) VM2-11X (H) New (1) VM5-9 PMB (H)	2 Source: 1 Phase: B PHASE Span: 62 Comments: NEW POLE New (124) 1/0 ACSR (C) New (4) 1/0 ACSR SAG (C) New (1) 40-4 (C) New (1) DVG10-15 (C) New (1) K14 (C) New (1) POLESET (C) New (1) VA5E (C) New (1) VM2-11 (C) New (1) VM5-9 PMB (C)	3 Source: 2 Phase: B PHASE Span: 70 Comments: 200AMP OHMP New (1) 2S 200A 120/240V OH (C) Comment: DID NOT GIVE METER BASE New (10) 2 TPX SAG (C) New (70) 2 TPX SERV (C) New (1) K10 (C)	
Locates: DIGTESS, CASH SUD, P1 = 32.980568 -95.885733		Misc. Remarks: ON POLE 108052, BUILD A NEW PRIMARY TAP AND SLACK SPAN ACROSS THE ROAD AND SET 1 NEW POLE. ON P2, INSTALL A NEW 15KVA XFMR AND INSTALL PERM OH SERVICE WIRE TO A 200AMP OHMP TO SERVE DWMH. MEMBER TO CUT TREES. RQS CONST RLS. RQS CR CROSSING PERMIT. RQS 2 EASE (PROP ID: 27966)(PROP ID: 28008). XFMR AND METER ARE IN GRID 14-33010170059. R1/R1. ATC DUE. JTHOMAS	